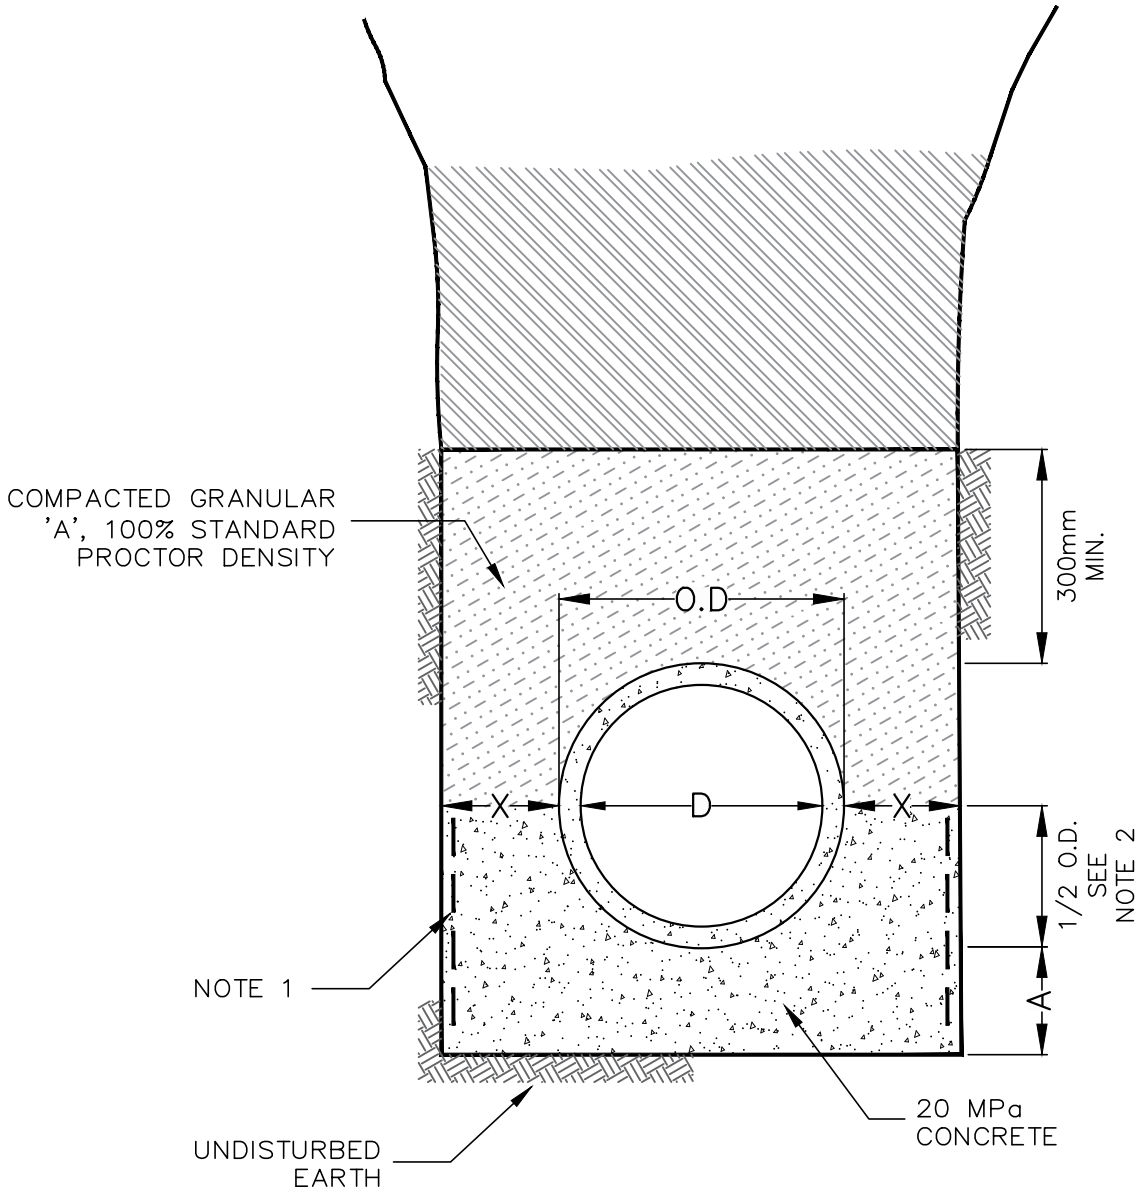

NOTES:

1. WHERE SHEATHING IS USED, A BOND BREAKING MATERIAL IS REQUIRED BETWEEN CONCRETE AND SHEATHING.
2. O.D. IS NOT TO INCLUDE BELL.

LEGEND:

A = D/4 BUT NO LESS THAN 150mm, OR AS DIRECTED BY CITY ENGINEER.

X = ① 100mm MIN. – 150mm MAX. FOR D 900mm or SMALLER.
② 150mm MIN. – 250mm MAX. FOR D 900mm – 1500mm.
③ 250mm MIN. – 300mm MAX. FOR D 1600mm or LARGER.

NOT TO SCALE

CITY OF WINDSOR

ENGINEERING DEPARTMENT

BEDDING DETAIL FOR SEWER PIPE CLASS A

DR'N BY: MP, AZ	DATE: MAR, 1979
REV. DATE: MAR, 2024	CH'KD BY(ENG): PM, JH
CH'KD BY(GEO/OPS): PJU, AL	PASSED BY: FM

Mark Winterton
CITY ENGINEER
Digitally signed by Mark Winterton
Date: 2024.03.27 11:02:48 -04'00'

AS–310A