


*
COMPACTED GRANULAR 'A'
100 % STANDARD
PROCTOR DENSITY

NOTE 1

UNDISTURBED
EARTH

15 MPa
CONCRETE

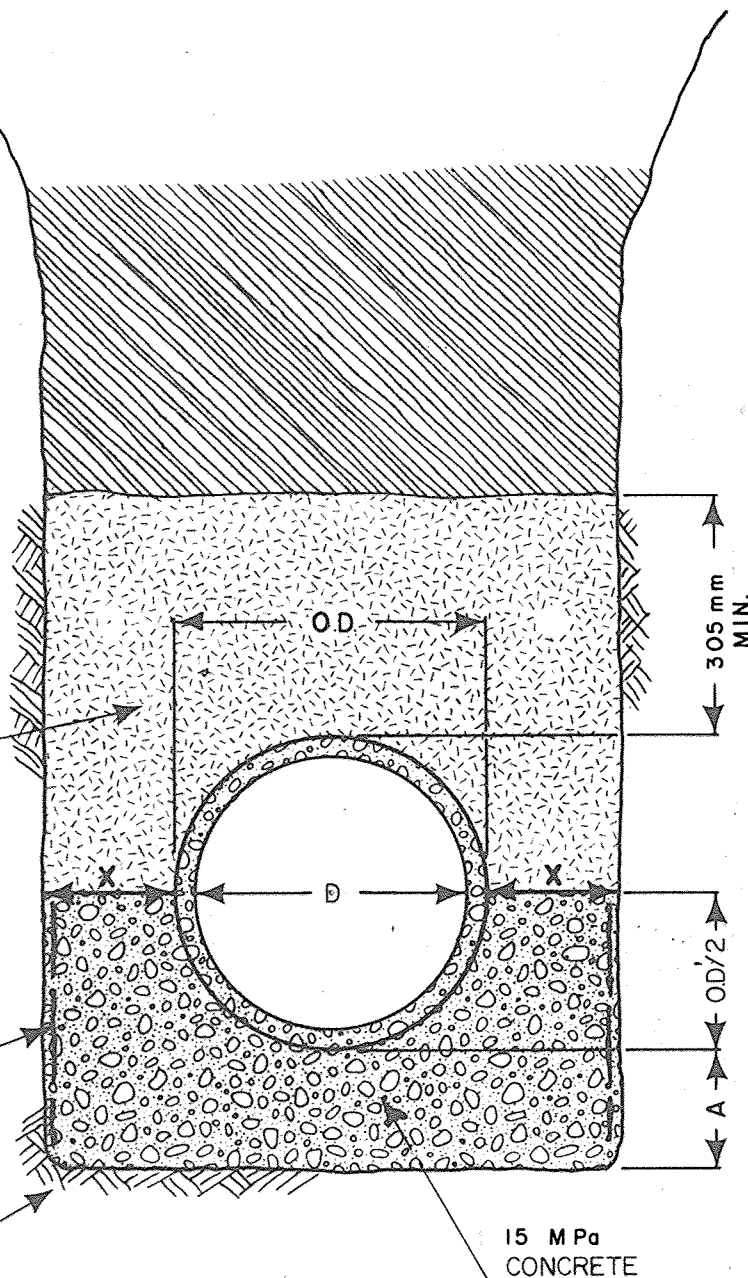

NOTES :

1. WHERE SHEATHING IS USED, A BOND BREAKING MATERIAL IS REQUIRED BETWEEN CONCRETE AND SHEATHING.
2. O.D. IS NOT TO INCLUDE BELL.

LEGEND :

- A = $D/4$ BUT NOT LESS THAN 152 mm
- X = $\begin{cases} 102 \text{ mm MIN. - } 152 \text{ mm MAX. (D 910 mm OR LESS)} \\ 152 \text{ mm MIN. - } 229 \text{ mm MAX. (D 990 mm TO 1520 mm Incl.)} \\ 229 \text{ mm MIN. - } 305 \text{ mm MAX. (D 1680 mm OR OVER)} \end{cases}$

* REVISION 1 AUG. 26/74 D.S. :

CITY OF WINDSOR DEPARTMENT OF PUBLIC WORKS	
BEDDING DETAIL FOR SEWER PIPE CLASS A	
DR'N BY : M.P.	DATE: MARCH, 1979
REVISION :	CH'KD BY:
CH'KD BY	PASSED BY:
COMMISSIONER OF WORKS	AS- 310A