


\*  
 COMPACTED GRANULAR 'A'  
 100% STANDARD  
 PROCTOR DENSITY

NOTE 1

UNDISTURBED  
 EARTH

15 MPa  
 CONCRETE

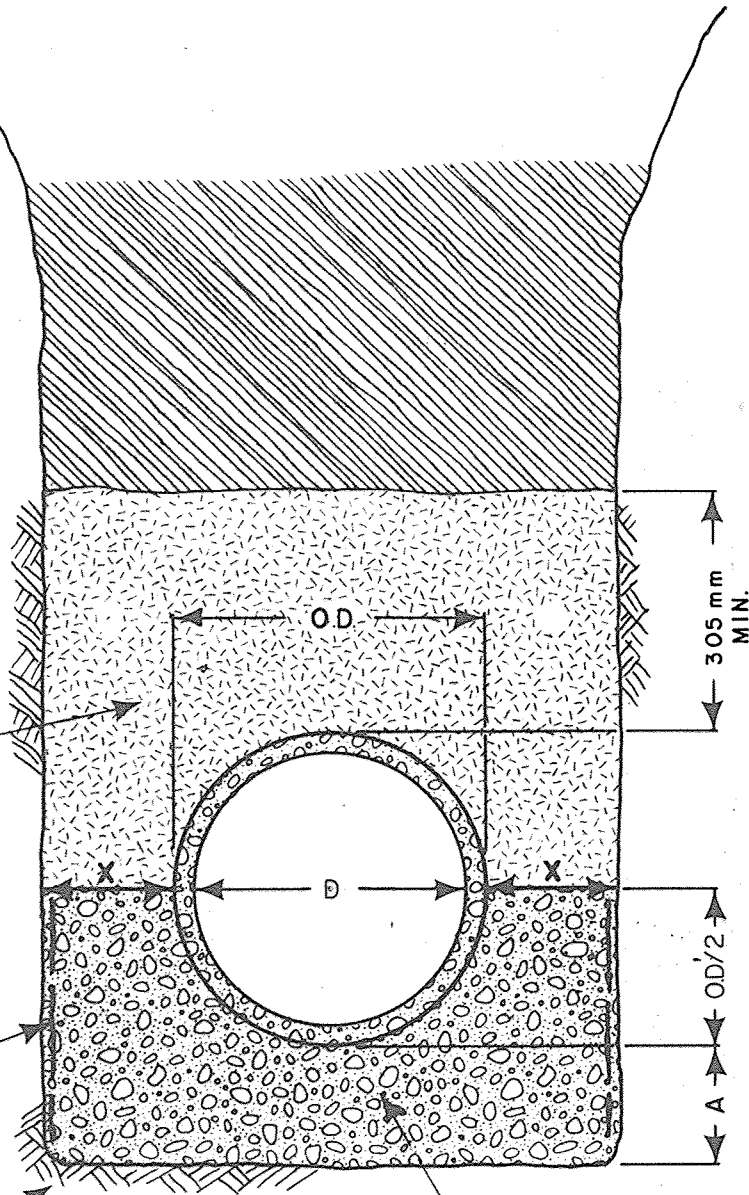

**NOTES :**

1. WHERE SHEATHING IS USED, A BOND BREAKING MATERIAL IS REQUIRED BETWEEN CONCRETE AND SHEATHING.
2. O.D. IS NOT TO INCLUDE BELL.

**LEGEND :**

- A =  $D/4$  BUT NOT LESS THAN 152 mm
- X =  $\left\{ \begin{array}{l} 102 \text{ mm MIN. - } 152 \text{ mm MAX. (D 910 mm OR LESS)} \\ 152 \text{ mm MIN. - } 229 \text{ mm MAX. (D 990 mm TO 1520 mm Incl.)} \\ 229 \text{ mm MIN. - } 305 \text{ mm MAX. (D 1680 mm OR OVER)} \end{array} \right.$

\* REVISION 1 AUG. 26/74 D.S. :

CITY OF WINDSOR DEPARTMENT OF PUBLIC WORKS	
BEDDING DETAIL FOR SEWER PIPE CLASS A	
DR'N BY : M.P.	DATE: MARCH, 1979
REVISION :	CH'KD BY:
CH'KD BY	PASSED BY:
COMMISSIONER OF WORKS	
AS- 310A	