


DIAMETER	MINIMUM SPACE BETWEEN EACH PIPE
UP TO 24"	12"
30" TO 72"	ONE HALF (1/2) DIAMETER OF PIPE
72" TO 180"	36"

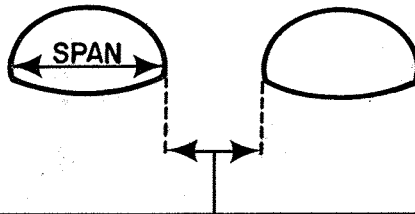

SPAN	MINIMUM SPACE BETWEEN PIPE ARCHES
UP TO 24"	12"
36" TO 108"	ONE THIRD (1/3) SPAN OF PIPE-ARCHES
108" TO 199"	36"

NOTE:

PREFERABLY, WHERE SPACE PERMITS, THE ENGINEER MAY DIRECT THAT THE PIPES OR THE PIPE-ARCHES SHALL BE LOCATED A SUFFICIENT DISTANCE APART TO PERMIT THE USUAL COMPACTION EQUIPMENT TO OPERATE LONGITUDINALLY BETWEEN THEM.

CITY OF WINDSOR DEPARTMENT OF PUBLIC WORKS	
SPACING FOR PIPES AND PIPE-ARCHES	
DRN BY : E.S.	DATE : MAY 30/75
REVISION :	CH KD BY : <i>ATA</i>
CH KD BY : <i>[Signature]</i>	PASSED BY :
<i>H. Payne</i> COMMISSIONER OF WORKS	AS-311