


PLAN VIEW

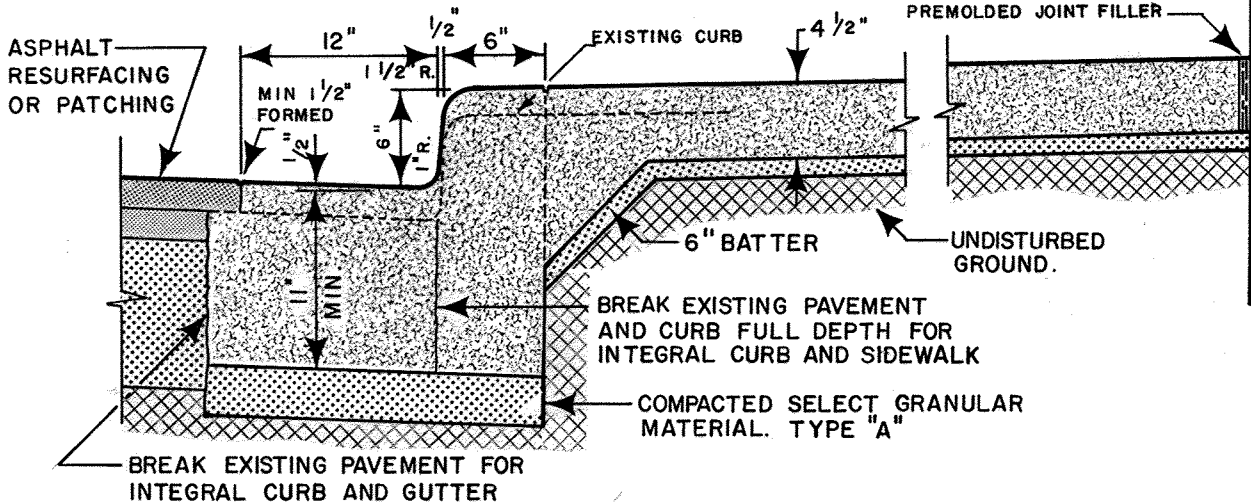

SECTION VIEW

NOTES :

1. CURB HEIGHT VARIES 5" TO 7" , STANDARD CURB HEIGHT 6"
2. SIDEWALK TO BE MARKED OFF INTO 2'-0" SQUARE FROM BACK OF CURB.
3. 1/2" TRANSVERSE EXPANSION JOINTS TO BE PLACED AT 10'-0" INTERVALS IN CURB , GUTTER AND 16' INTERVALS IN SIDEWALK.
4. ALL CONCRETE TO BE PROTECTED FROM THE ELEMENTS BY AN APPROVED CURING COMPOUND SPRAYED ON ALL EXPOSED SURFACES.
5. ALL EXPOSED CONCRETE TO BE SEALED WITH AN APPROVED SEALING COMPOUND.
6. AT ALL BUILDING ENTRANCES A NON EXTRUDING 1/2" EXPANSION JOINT TO BE FLUSH WITH TOP OF WALK BOTH SIDES OF JOINTING MATERIAL AND FACE OF BUILDING TO BE THOROUGHLY PAINTED WITH BITUMINOUS COMPOUND.
7. WHEN NEW CURB & GUTTER ABUTTS EXISTING PAVEMENT , JOINT AT EXISTING PAVEMENT SHALL BE SEALED WITH HOT BITUMINOUS COMPOUND AS SPECIFIED.
8. ALL CONCRETE TO BE 4000 P.S.I. , 5 TO 7% AIR ENTRAINED & MAX. 3" SLUMP.
9. ALL PREMOLDED JOINT FILLER SHALL CONFORM TO M.T.C. FORM 1309.
10. ALL WORK SHALL CONFORM TO CITY OF WINDSOR STANDARD SPECIFICATION S-9.

CITY OF WINDSOR	
DEPARTMENT OF PUBLIC WORKS	
RECONSTRUCTION OF INTEGRAL SIDEWALK , CURB AND GUTTER	
DRAWN BY : L.E.B.	DATE : AUG. 1976
REVISION :	CHECKED BY :
CHECKED BY: <i>[Signature]</i>	PASSED BY: <i>[Signature]</i>
<i>[Signature]</i> COMMISSIONER OF WORKS	
AS-506	