



GRANULAR BACKFILL ENTIRE TRENCH GRANULAR 'B' TYPE I

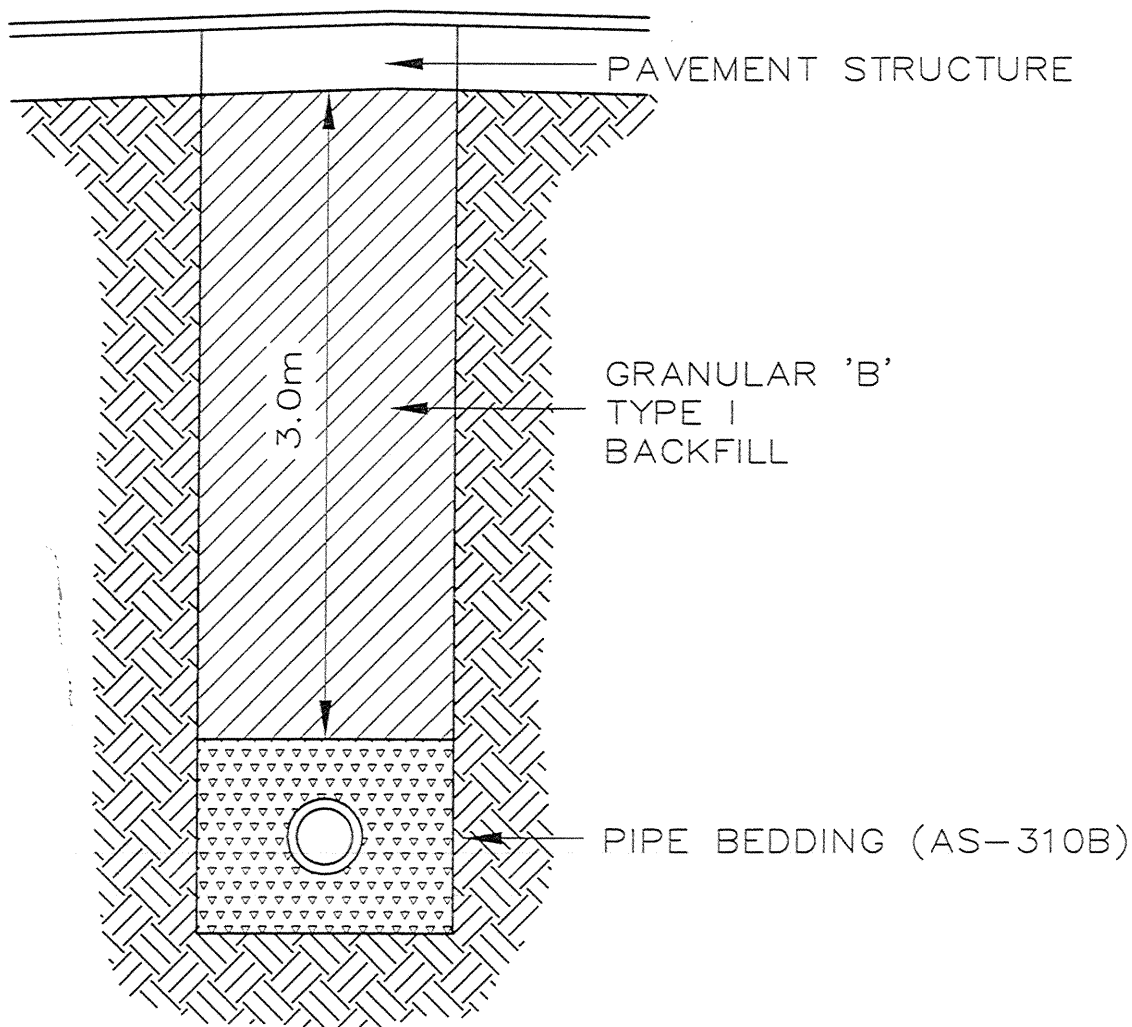

NOTES:

1. PIPE BEDDING AND CONNECTIONS MUST BE SEALED BY APPROVED MATERIALS TO PREVENT FINES MIGRATION OF GRANULAR 'B' TYPE I. (SEE AS-310B)
2. MAXIMUM ALLOWED DEPTH OF GRANULAR 'B' TYPE I SHALL BE 3.0 METRES FROM UNDERSIDE OF PAVEMENT STRUCTURE UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.

CITY OF WINDSOR INFRASTRUCTURE SERVICES	
Granular Backfill: Entire Trench Granular 'B' Type I	
DRAWN BY: S.S.	DATE: APRIL, 2004
	CHECKED BY: V.F.
CHECKED BY: P.W.	PASSED BY: T.M.
 CITY ENGINEER	
AS-519	