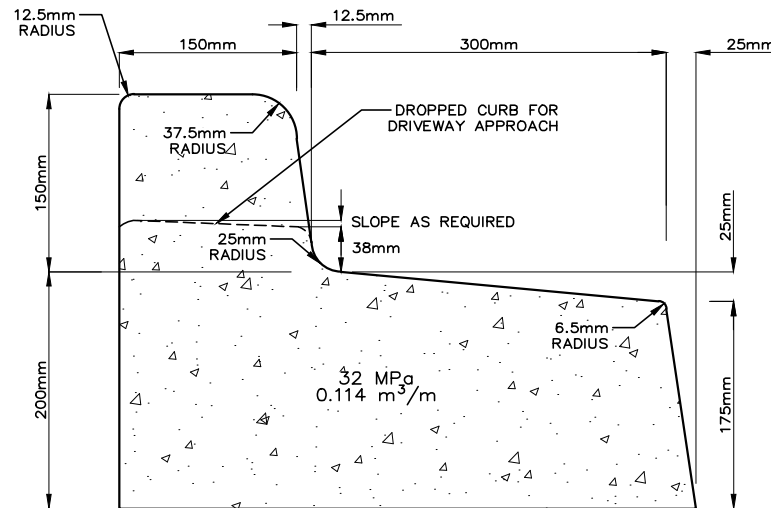


STANDARD CURB & GUTTER





SUPERELEVATED CURB & GUTTER

NOTES:

1. PREFORMED JOINT FILLER SHALL BE 12mm THICK, FULL DEPTH, AS PER OPSS.MUNI 1308.
2. PREFORMED JOINT FILLER SHALL BE INSTALLED AT:
 - a) EITHER END OF CURB REPAIRS AND REPLACEMENTS
 - b) WHERE CURB AND GUTTER IS PLACED ABUTTING EXISTING CURB
 - c) AT MAX. 3.0m INTERVALS ALONG CURVES WITH RADIUS LESS THAN 9.0m
 - d) AT MAX. 4.9m INTERVALS ELSEWHERE
3. CONTRACTION JOINTS FOR ASPHALT SURFACES TO BE SPACED 5m AND COINCIDE WITH THE CONTRACTION JOINTS FOR CONCRETE PAVEMENTS.
4. CROSS FALL OF GUTTER SHALL CONFORM TO PAVEMENT CROSS FALL AT CATCH BASIN.
5. ALL WORK SHALL CONFORM TO CITY OF WINDSOR SPEC. S-5.

NOT TO SCALE

 CITY OF WINDSOR ENGINEERING DEPARTMENT	
STANDARD & SUPERELEVATED CURB & GUTTER FOR RESIDENTIAL ROADS	
DR'N BY: ET, PR, AZ	DATE: MAR, 2017
REV. DATE: MAR, 2025	CH'KD BY(ENG):PM, SC
CH'KD BY(GEO/DPS): PJJ, AL	PASSED BY: FM
 CITY ENGINEER	
AS-208	